


See Sheet E3

Sudo Room/CCL Bordre

- Notes:
1. 120Vplugs shall be placed no further than 12 ft apart
 2. Plugs shall be installed 18" above the floor

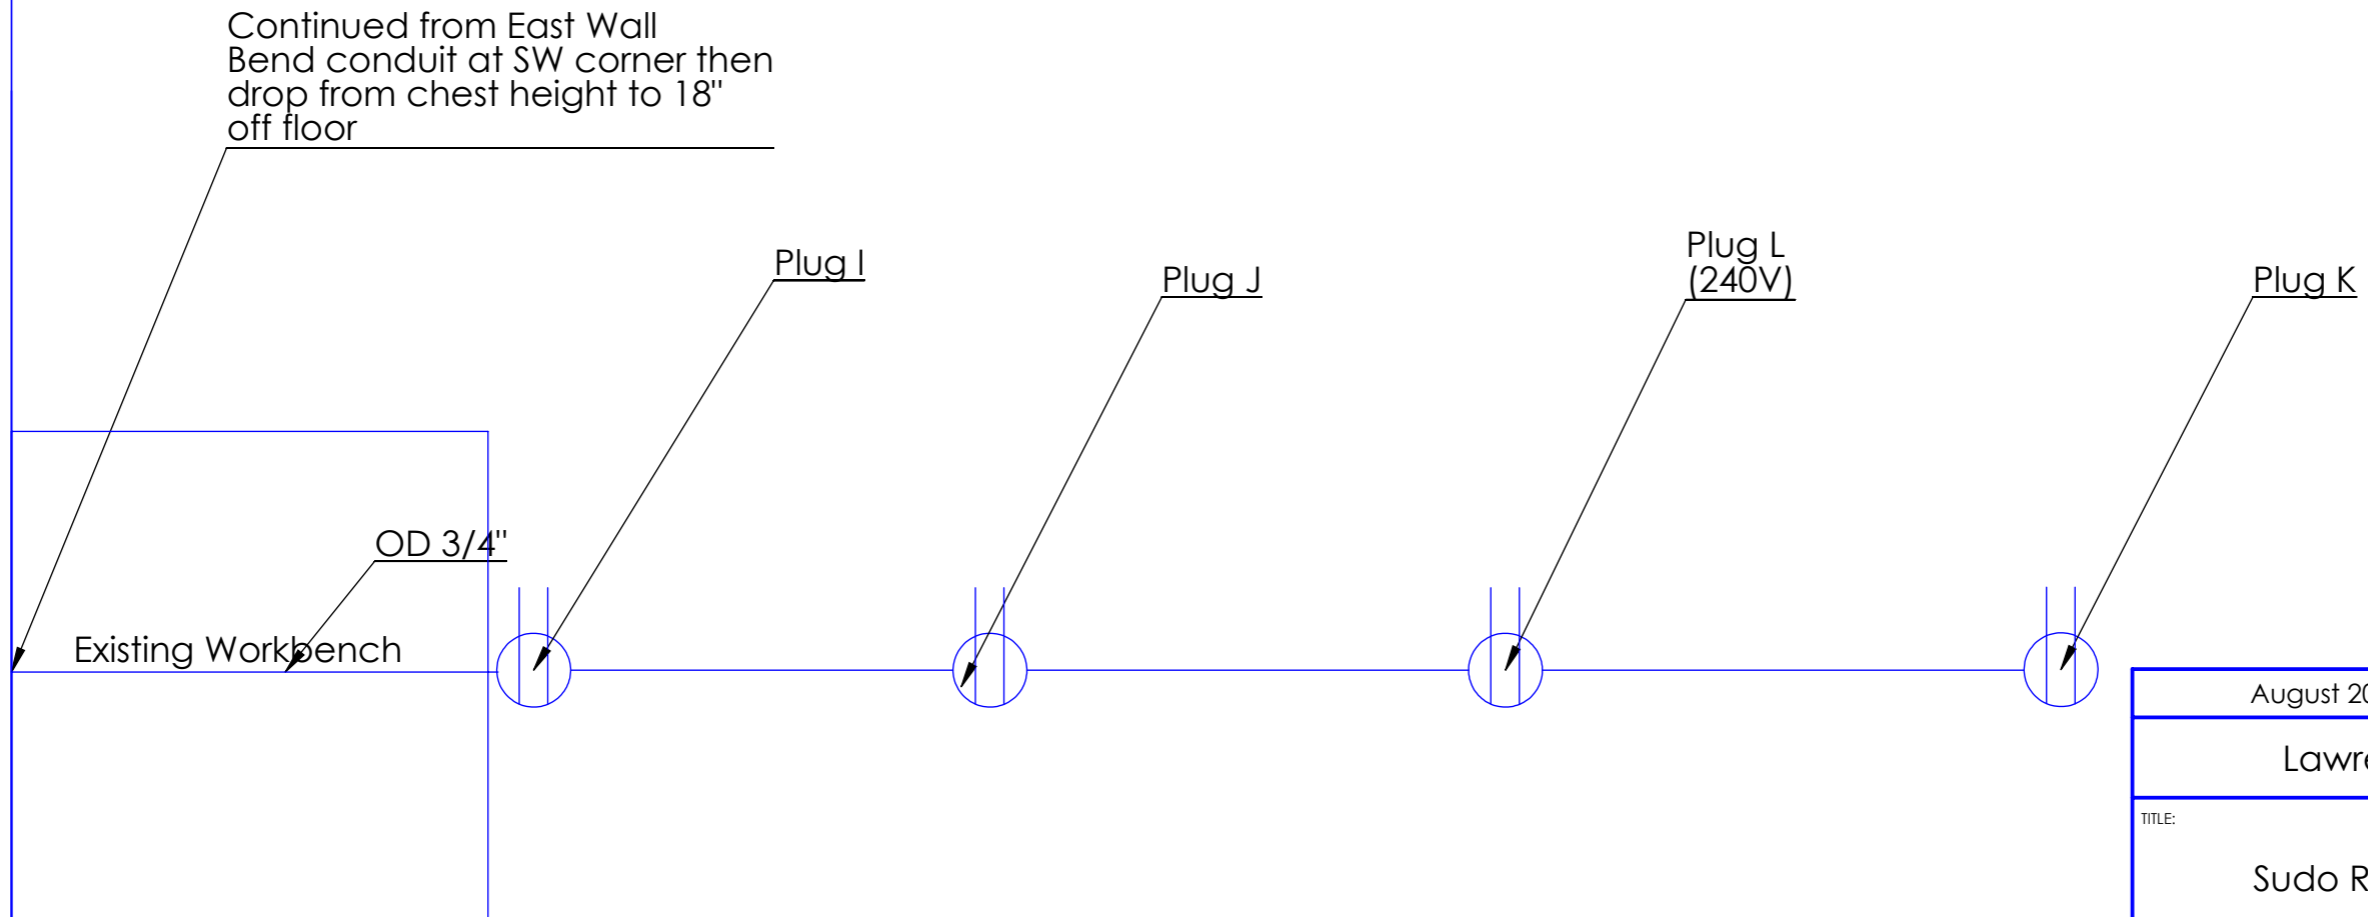

August 2014	REVISION 1.1
Lawrence Engineering	
TITLE: Sudo Room Electrical	
DWG NO. E4-West Wall Conduit Layout	A3
Drawing Not to Scale	SHEET 5 OF 8