


Notes:

- 1. J-box #3 is recommended for future installation of power access where shelving elements currently exist.

See Sheet E2

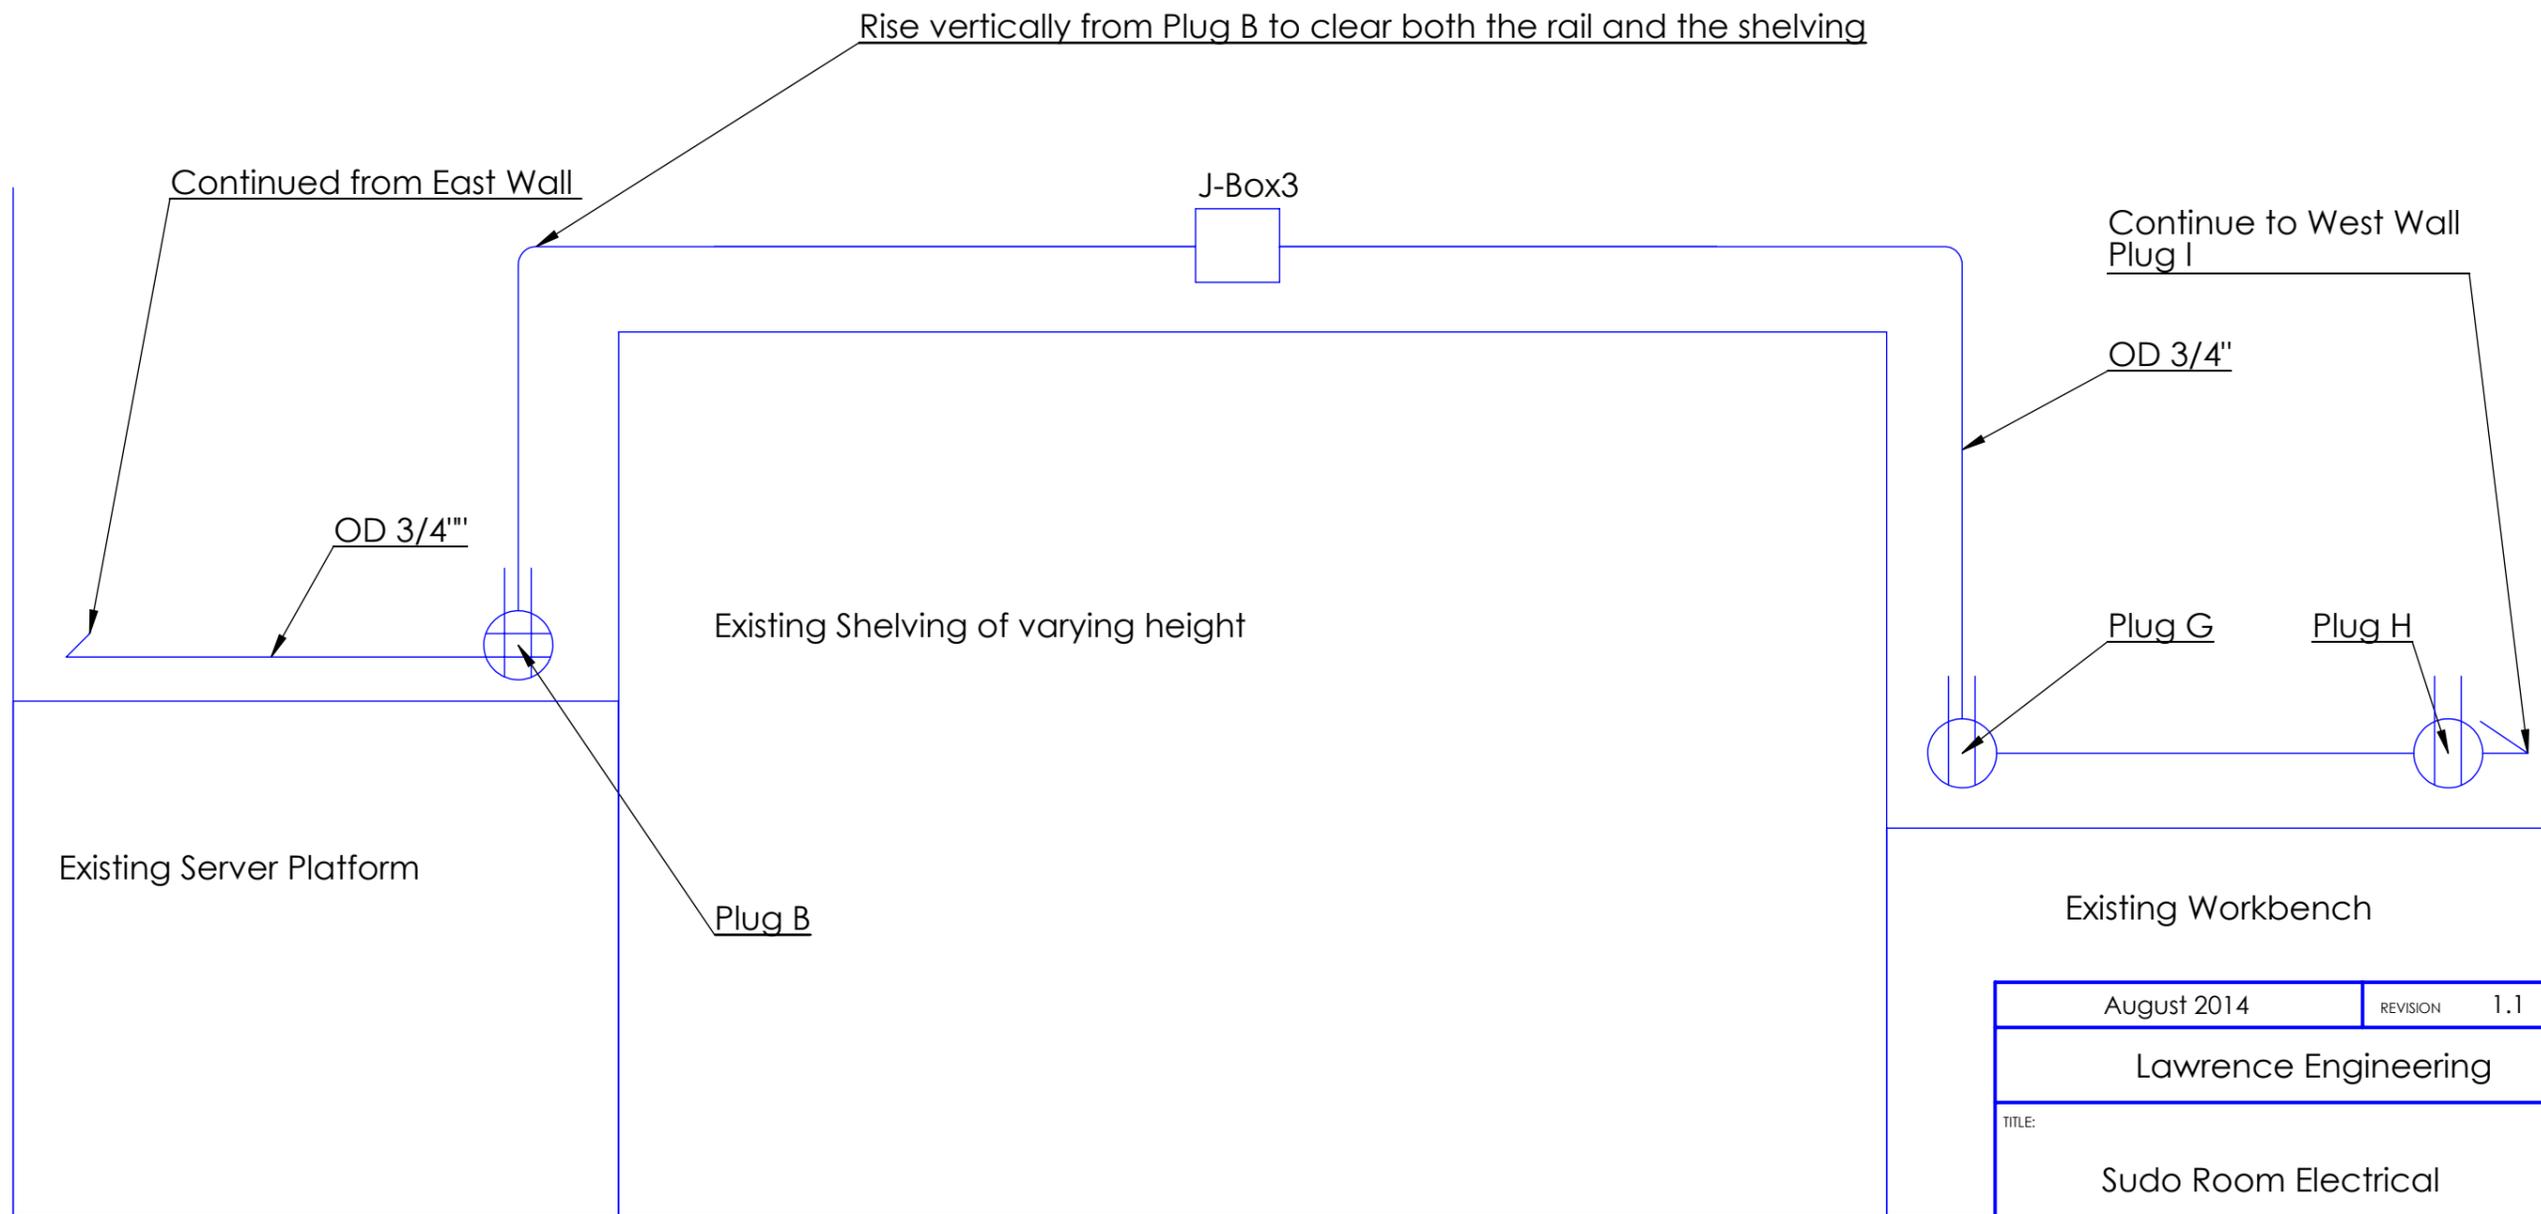

See Sheet E4

| | | |
|---|--------------|-----|
| August 2014 | REVISION | 1.1 |
| Lawrence Engineering | | |
| TITLE: Sudo Room Electrical | | |
| DWG NO. E3-South Wall Conduit Layout | A3 | |
| Drawing Not to Scale | SHEET 4 OF 8 | |